Drawing Number	REV
PPS-0420	A

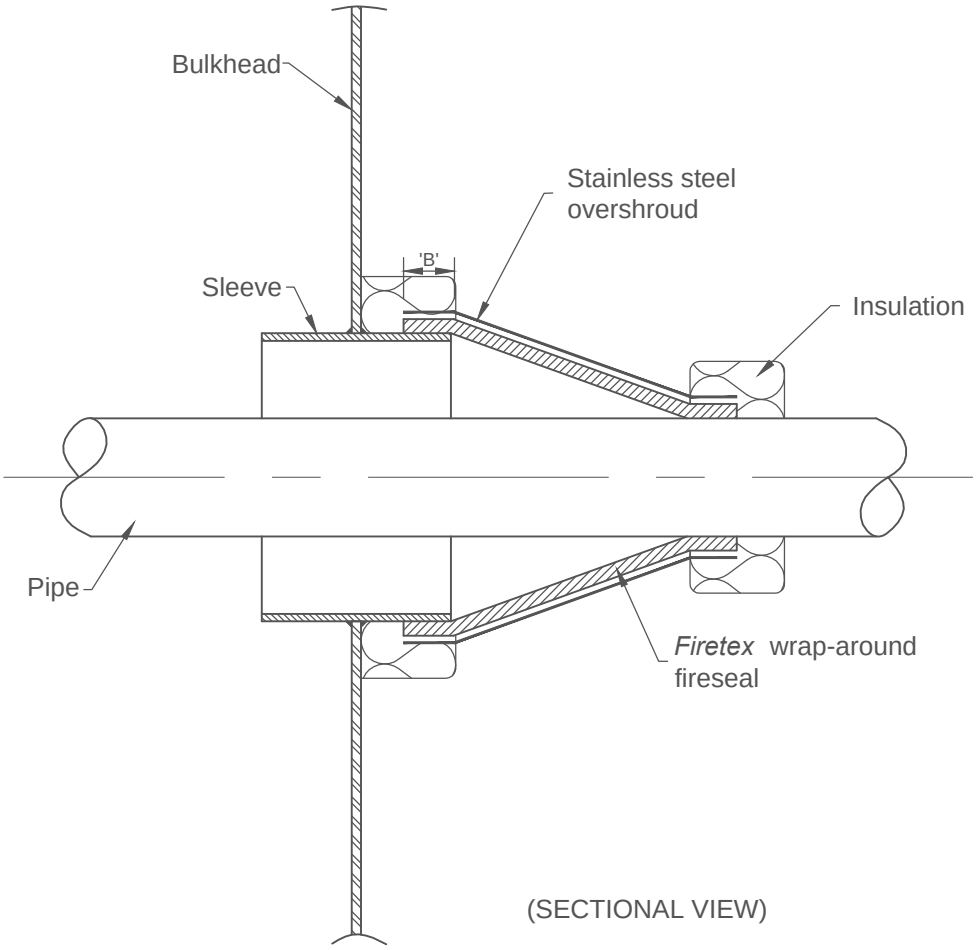

(SECTIONAL VIEW)

Notes:

INSULATION: Jet fire seal clips should be insulated.

CERTIFICATION: Tested to J120 in accordance with HSE standard OTI 95 634 Lloyd's Register of Shipping, Certificate No. SAS F000329, Blast over-pressure to 1.35 bar g, Lloyd's Register of Shipping Certificate No. LWT 401087/1.

CLIPPING: Each seal is supplied with fitting instructions, adhesive and stainless steel worm drive clips to suit pipe and sleeve diameters. For diameters of 350mm and above 'double clipping' is required. The clipping length or cuff (B) is 50mm for single clips and 75mm for double clips.

Drawing Title:

STAINLESS STEEL SHROUDED PIPE PENETRATION SEAL SYSTEM - J120

MCL UNITEX LTD
MCL House, Adams Close,
Heanor Gate Industrial Park,
Heanor, Derbyshire,
DE75 7SW
United Kingdom
Tel: +44 (0)1773 761226
Fax: +44 (0)1773 533478
Web: www.mclunitex.com

O05151

Rev	Date	Revision detail	Drn	Chk'd	App'd
A	02/06/10	Certification number revised	M.A.T.	J.D.	N.R.T.
0	06/10/05	Drawing created	J.D.	N.R.T.	I.C.K.

Drawing Number	REV
PPS-0420	A